


VALLEY SANITATION DISTRICT

Sewer Pipe Installed By Year

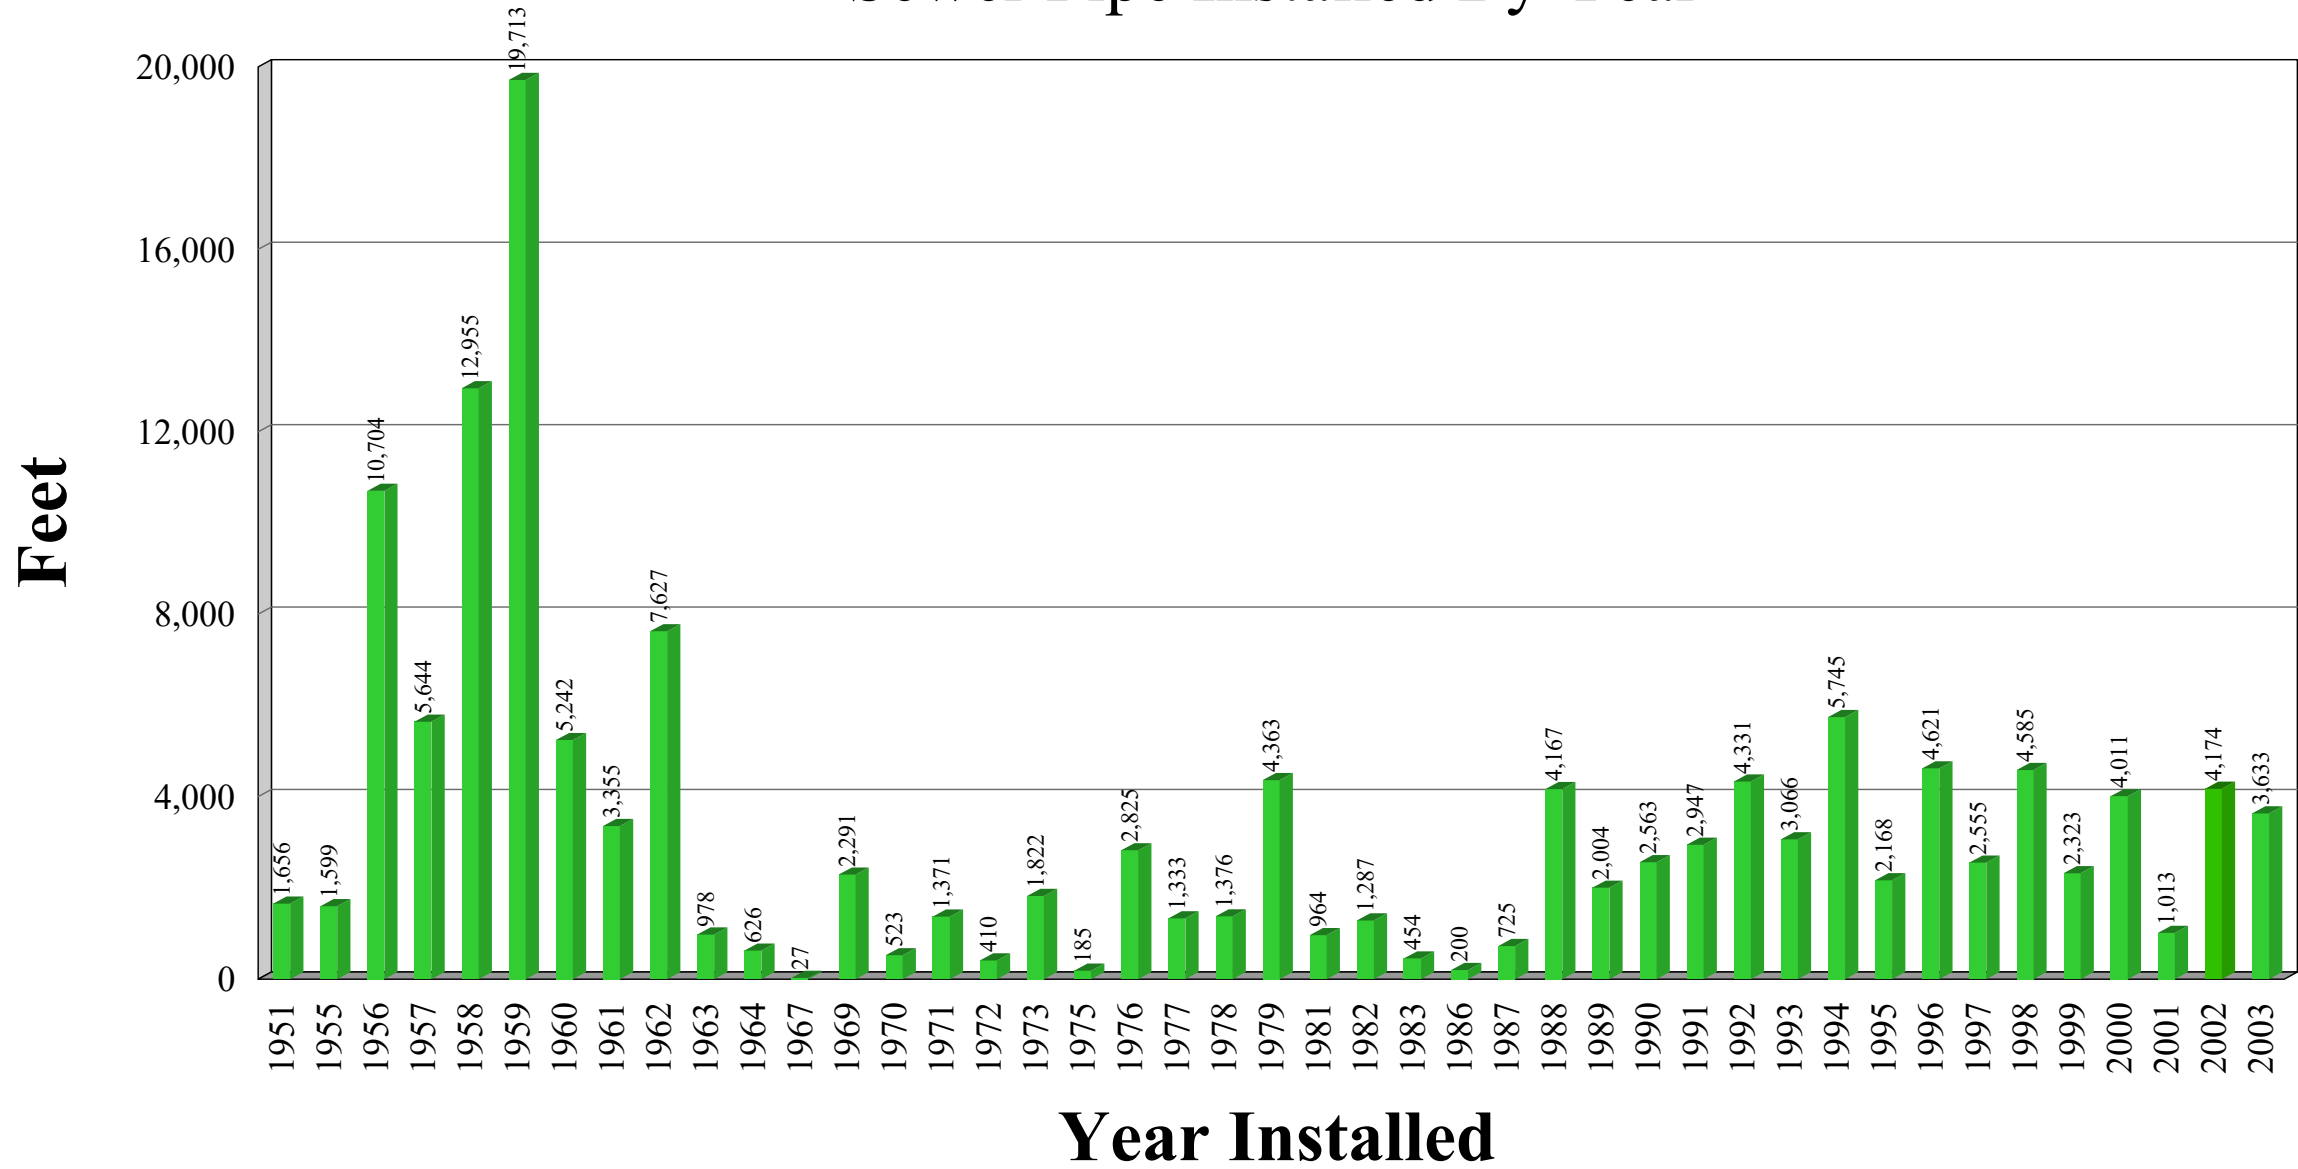

	6		8					10					12			15	18				21		24				Total
	SLIPLINED VITRIFIED CLAY PIPE	C-900 POLYVINYL CHLORIDE PIPE	Concrete Pipe (non-reinforced)	CURED IN PLACE PIPE	Polyvinyl Chloride	SLIPLINED VITRIFIED CLAY PIPE	Vitrified Clay Pipe	C-900 POLYVINYL CHLORIDE PIPE	Concrete Pipe (non-reinforced)	Polyvinyl Chloride	SLIPLINED REINFORCED CONCRETE PIPE	Concrete Pipe (non-reinforced)	SLIPLINED REINFORCED CONCRETE PIPE	Vitrified Clay Pipe	CURED IN PLACE PIPE	Concrete Pipe (non-reinforced)	CURED IN PLACE PIPE	Ductile Iron Pipe	SLIPLINED REINFORCED CONCRETE PIPE	Reinforced Concrete Pipe	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	Ductile Iron Pipe	Reinforced Concrete Pipe	SLIPLINED REINFORCED CONCRETE PIPE		
1989	0	0	0	0	0	2,004	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,004	
1990	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,563	0	0	0	0	2,563	
1991	0	0	0	0	670	911	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,366	2,947	
1992	0	0	0	0	0	1,201	0	0	0	0	0	50	2,780	0	0	0	0	0	300	0	0	0	0	0	0	4,331	
1993	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,843	0	0	0	0	1,223	3,066	
1994	0	0	0	0	0	3,611	453	0	0	1,361	0	0	0	0	0	0	0	0	0	0	320	0	0	0	0	5,745	
1995	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,168	0	0	0	0	2,168	
1996	0	2,375	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,246	0	0	0	0	4,621	
1997	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,507	0	1,048	0	0	0	0	2,555	
1998	0	0	0	2,665	0	1,920	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4,585	
1999	0	0	0	1,648	0	675	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,323	
2000	0	0	0	4,011	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4,011	
2001	0	0	0	1,013	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,013	
2002	0	0	0	2,933	0	0	0	0	0	0	0	0	0	1,241	0	0	0	0	0	0	0	0	0	0	0	4,174	
2003	0	0	0	940	0	0	0	0	0	0	0	0	0	0	0	2,693	0	0	0	0	0	0	0	0	0	3,633	
Total	140	3,105	40,838	17,988	2,791	17,787	33,903	669	185	1,361	475	342	3,113	185	1,241	11	2,693	454	1,807	230	11,186	5	277	785	2,589	144,160	